


Fire Safety and Alarms

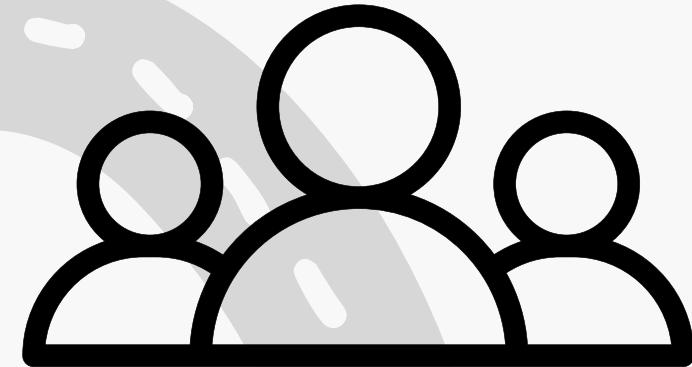


Occupancy

> 49 occupants: Group B

100+ occupants: Group A

300+ occupants: Group A

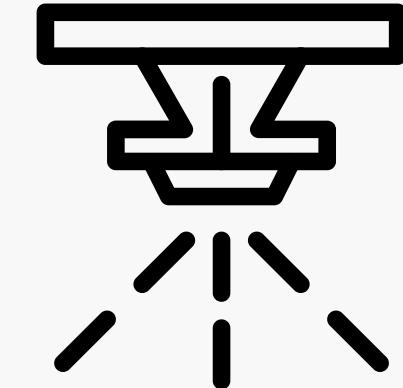

Sprinkler System

100+ Occupancy


5,000 ft² of space

Not on Ground Level

Classified Nightclub

Spaces with 350 ft of Open

Standing Room

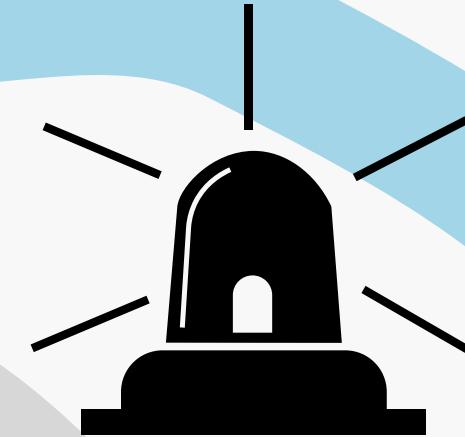

Alarm System

Fire Area Occupancy of 300+

OR

**Sprinkler System with 20+
sprinkler heads**