



TOP VIEW

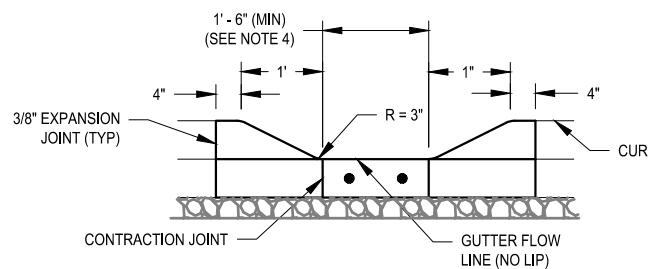


SECTION B-B

**GENERAL NOTES:**


1. CURB INLET SHALL BE CONSTRUCTED IN ACCORDANCE WITH ASTM C-478 (AASHTO M 199) & ASTM C-890 UNLESS OTHERWISE SHOWN ON PLANS OR NOTED IN THE PROJECT SPECIAL PROVISIONS.
2. TOP SURFACE TO BE BROOM FINISHED.
3. ALL EXTERNAL EDGES NOT LABELED SHALL BE TROWELED WITH 1/4" RADIUS EDGER.
4. WIDTH TO BE DETERMINED BY DESIGN ENGINEER.
5. CONCRETE SPILLWAY SHALL EXTEND TO SWALE BOTTOM.
6. SUBGRADE AND CRUSHED SURFACE TOP COURSE SHALL BE COMPACTED TO 90%.

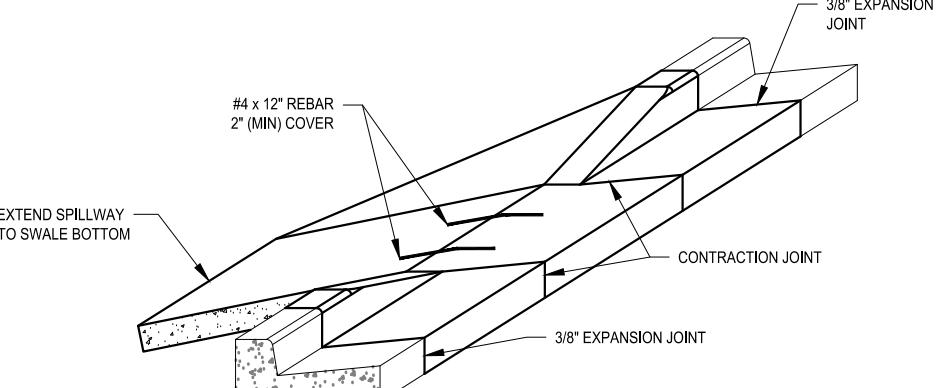

ISOMETRIC VIEW

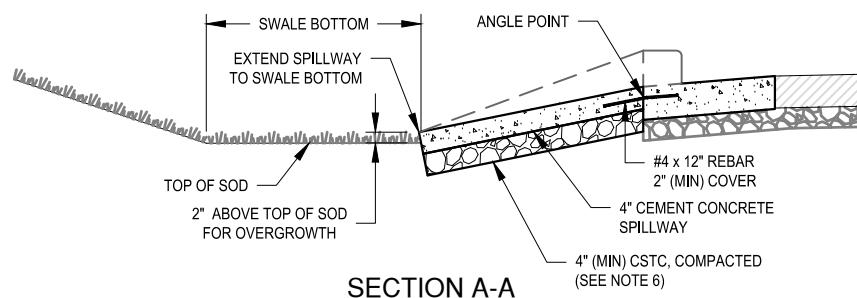

SECTION A-A

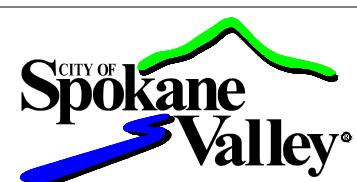

APPROVED BY:

ROBERT B. BLEGEN, P.E.  
PUBLIC WORKS DIRECTOR

**CURB INLET TYPE 1**

**STANDARD PLAN NO.  
S-110**

PUBLICATION DATE: 03/2025

REVISION NO.: 01