


GENERAL NOTES:


1. EXPANSION JOINT MINIMUM REQUIREMENTS:
 - a. 3/8" EXPANSION JOINT MATERIAL SHALL BE PLACED AT LEAST EVERY 15' IN WIDTH WITHIN THE DRIVEWAY APPROACH AND SHALL LINE UP WITH SIDEWALK EXPANSION JOINTS IF APPLICABLE.
 - b. 3/8" EXPANSION JOINT MATERIAL IS REQUIRED BETWEEN DRIVEWAY SLAB AND THE SIDEWALK AND THE DRIVEWAY APPROACH.
 - c. EXPANSION JOINT MATERIAL SHALL BE SECURED IN PLACE PRIOR TO CONCRETE PLACEMENT AND SHALL COMPLETELY SEPARATE ADJACENT SLABS EXTENDING FROM THE SURFACE TO GRAVEL BASE. PLACEMENT OF EXPANSION JOINT MATERIAL SHALL NOT BE FLOATED OR PRESSED INTO WET CONCRETE AFTER CONCRETE HAS BEEN PLACED.
 - d. AN ALTERNATIVE TO SETTING EXPANSION JOINT MATERIAL PRIOR TO PLACING CONCRETE WOULD BE TO SAW CUT FULL DEPTH 1/2" WIDE AND FILL WITH APPROVED MASTIC PER WSDOT 9-04.2(2) POURED RUBBER JOINT SEALER.
2. CONTROL JOINTS SHALL BE PLACED AT THE DISCRETION OF THE CONTRACTOR. CRACK REPAIR WITHIN THE WARRANTY PERIOD IS THE RESPONSIBILITY OF THE CONTRACTOR. CONTROL JOINT MINIMUM REQUIREMENTS; CONTROL JOINTS SHALL:
 - a. BE NO FARTHER APART THAN 10'.
 - b. NOT EXCEED A RATIO OF 1 TO 1.25 LENGTH TO WIDTH.
 - c. BE A MINIMUM OF 1" DEEP (FOR TROWEL OR SAW CUT).
 - d. BE ADDED AT ALL GRADE BREAKS.
3. CEMENT CONCRETE SHALL BE CLASS 4,000 CONCRETE PER SECTION 6-02 OF THE WSDOT STANDARD SPECIFICATIONS.
4. ALL EXTERNAL EDGES SHALL BE TROWELED WITH A 3/8" TO 1/2" RADIUS.
5. A 4" (MIN) THICK CSTM LAYER SHALL BE PLACED UNDER DRIVE APPROACH.

ISOMETRIC VIEW

6. FIRST 2' OF DRIVE APPROACH (AT CURB SIDE) SHALL BE THICKENED TO MATCH BOTTOM OF CURB.
7. WHEN AN ASPHALT APPROACH IS USED THE ASPHALT SHALL BE PLACED IN 0.30' LIFTS PER WSDOT 5-04.3(7)
8. LAST 2' OF SIDEWALK (HOUSE SIDE) WILL BE THICKENED 2 EXTRA INCHES WHEN OTHER HARD SURFACES ARE NOT PROPOSED ADJACENT TO THE APPROACH.
9. SUBGRADE AND CSTM UNDER APPROACH SHALL BE COMPACTED TO 95%.
10. ALL BROKEN, CRACKED, HEAVED AND SUNKEN CONCRETE SHALL BE REMOVED AND REPLACED FROM JOINT TO JOINT.
11. PERIMETER EDGING SHALL NOT BE ALLOWED UNLESS IT IS FOR A REPAIR/REPLACEMENT OF EXISTING PANELS AND ONLY WHEN MATCHING ADJACENT PANELS. CONTRACTOR SHALL MAKE AN EFFORT TO MATCH EXISTING PANELS IN ACCORDANCE WITH DIRECTION FROM CITY INSPECTOR.
12. ALL CHANGES IN LEVEL ACROSS JOINT MUST BE FLUSH WITH A MAXIMUM DIFFERENCE IN ELEVATION OF 3/16".
13. FOR ROADSIDE SWALE APPLICATIONS, INSTALL 8" DIP CULVERT UNDER APPROACH PER SPOKANE REGIONAL STORMWATER MANUAL. ENDS SHALL BE BEVELED TO MATCH SWALE SLOPE. THERE SHALL BE 10" (MIN) OF COVER, INCLUDING CONCRETE AND CSTM, OVER THE CULVERT.
14. MONO-PLACEMENT OF CURBS AND CROSS GUTTER WITH OTHER STRUCTURES SUCH AS SIDEWALKS AND APPROACHES SHALL NOT BE ALLOWED AND SHALL BE SEPARATED WITH EITHER A COLD JOINT OR EXPANSION JOINT SEALED WITH A POURED RUBBER JOINT SEALER PER WSDOT 9-04.2(2).
15. SAWCUTTING OF CURB TO CREATE CURB DROP IS NOT ALLOWED.
16. ALL APPROACHES SHALL BE PER CITY STREET STANDARDS 7.3 AND 7.8.
17. EXCEPT FOR JOINTS AND BROOM FINISHING, NO OTHER MARKINGS ARE PERMITTED ON THE WALKING SURFACE.
18. TYPE A CURB TO BE USED ONLY WHEN MATCHING EXISTING CURB AND WITH APPROVAL OF THE CITY ENGINEER.

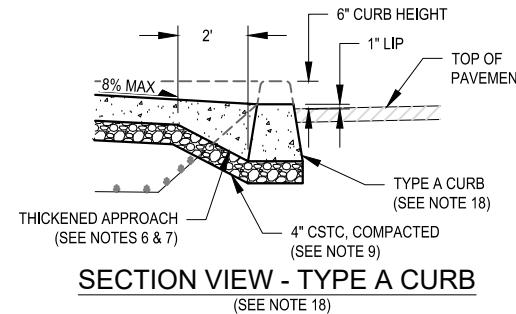

SECTION VIEW - TYPE A CURB
(SEE NOTE 18)

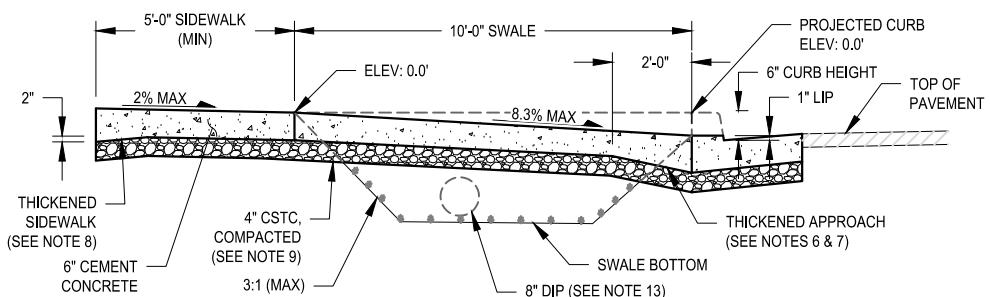

SECTION A-A



APPROVED BY:


ROBERT B. BLEGEN, P.E.
PUBLIC WORKS DIRECTOR

**TYPE I CONCRETE
APPROACH
SEPARATED SIDEWALK
STANDARD PLAN NO.
R-110**

PUBLICATION DATE: 09/2025

REVISION NO.: 03