


ISOMETRIC VIEW

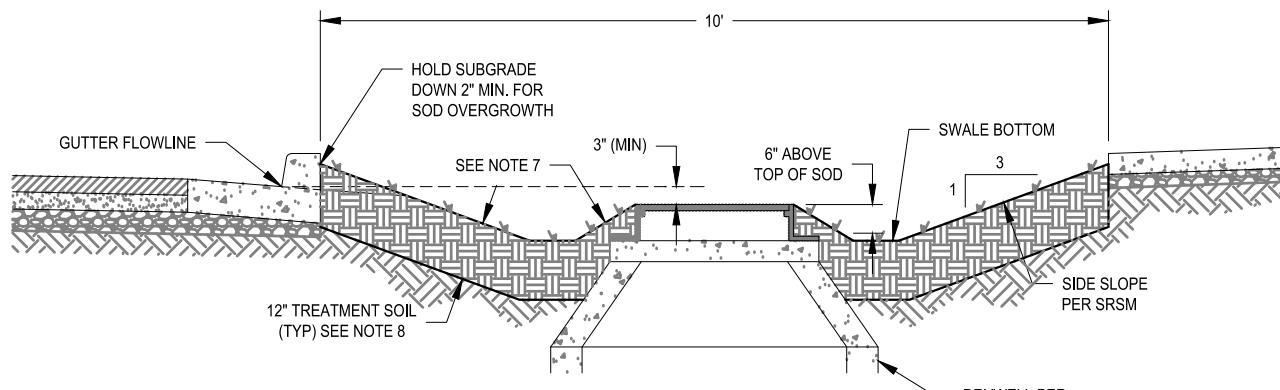

SECTION A-A

## GENERAL NOTES:

1. SWALES WITH LONGITUDINAL SLOPE GREATER THAN 1% REQUIRE CHECK DAMS.
2. DRYWELLS NOT TO BE WITHIN 5' - 9" OF INLET CENTERLINE.
3. NO MORE THAN 4" OF TOPSOIL OVER UNCOMPACTED NATIVE SOIL.
4. NO COMPACTION IN SWALE BOTTOM.
5. SWALES ARE TO BE GRASSED AND IRRIGATED AS NECESSARY. SWALES WITHOUT IRRIGATION SHALL HAVE DROUGHT-TOLERANT DRYLAND GRASS.
6. SWALES SHALL BE CONSTRUCTED IN CONFORMANCE WITH THE SPOKANE REGIONAL STORMWATER MANUAL (SRSM).
7. TOPSOIL SHALL BE SLOPED AROUND DRYWELL FRAME FROM BOTTOM OF SWALE TO TOP OF FRAME AT 3:1 MAXIMUM SLOPE.
8. THE TOP 12" OF SOIL SHALL CONSIST OF A THOROUGHLY BLENDED MIX OF 50% COMPOST WITH 50% NATIVE SOIL.



APPROVED BY:

ROBERT B. BLEGEN, P.E.  
PUBLIC WORKS DIRECTOR

ROADSIDE SWALE

STANDARD PLAN NO.  
S-130

PUBLICATION DATE: 03/2025

REVISION NO.: 01